



SUPPORTS - SECONDARY BUS INSULATOR

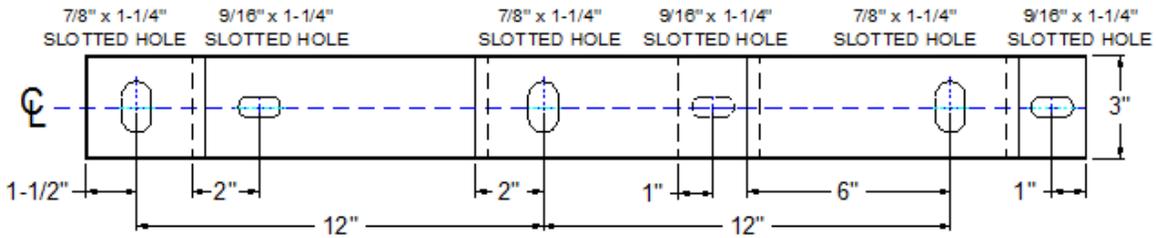

±1/8" TOLERANCE ON ALL BRACKET DIMENSIONS

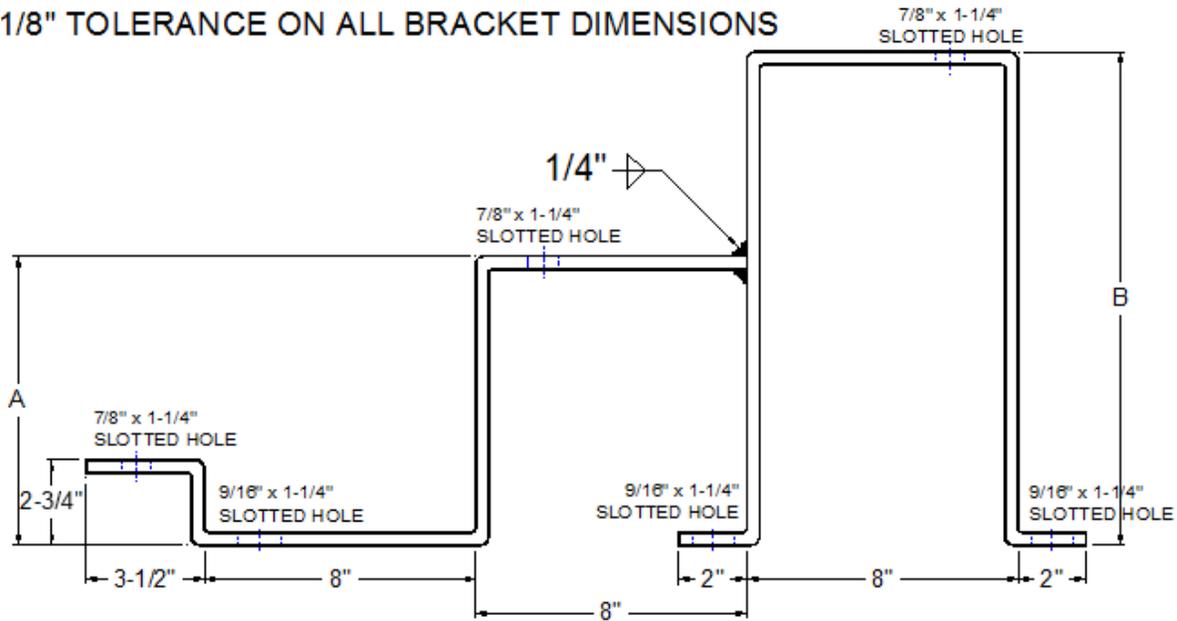

- Secondary Bus Insulator Supports** shall be of the configuration and dimensions shown, and shall be hot-formed from 3/8" x 3" carbon steel bars conforming to the requirements of ASTM A-36, latest revision. The supports shall be hot dipped galvanized after fabrication in accordance with ASTM specification A123, Grade 100.
- Reference Specifications:** ASTM A-36, A123, latest revisions.
- Stock Unit:** EA

Stock Number	Dimensions, inches		Support Type
	A	B	
696832	8-1/2	14-1/2	For installation in normal working space.
696836	6	9-1/2	For limited working space.

Standards Coordinator
Todd Oki

Standards Supervisor
John Shipek

Unit Director
Darnell Cola