STANDARD NUMBER:


NCI-99

PAGE: 1 of

DATE: November 3, 1988 REV: October 2, 2001

CONSTRUCTION GUIDELINE

LIGHT DUTY INSULATED SUPPORT ASSEMBLY NETWORK FACILITIES

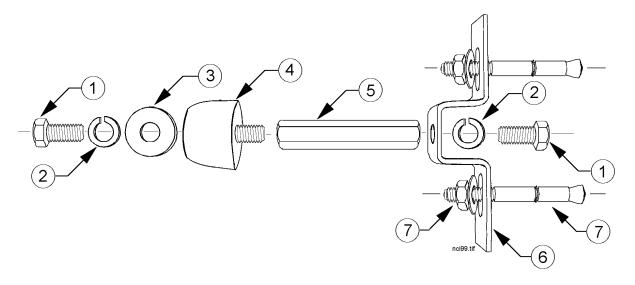

NOTES:

- 1. This assembly supports electrical devices which must be isolated from the facility they are installed in or from the reinforcing steel in a building or structure.
- 2. Safe working load on anchor stud bolts is 1900 lbs. (item 7, Quick Bolts).
- 3. Cantilever loading should not exceed 250 foot lbs. per assembly.
- 4. The base support, item 6, requires enlargement of the 9/16" diameter hole at the center to 11/16" to use the parts listed below.

Item	Qty.	Description	Stock No.	Matl. Std.
1	2	SCREW, cap, hex head, cad plated, 5/8" - 11 NC x 1"	784885E	7847.1
2	2	WASHER, 5/8" lock, galvanized	584260E	5842.1
3	1	WASHER, flat, 5/8"	585030E	5847.1
4	1	INSULATOR, Dirigo spool, neutral bus support	690880	6908.0
5	1	NUT, coupling, hex, steel, 5/8" - 11 NC	780050E	-
6	1	BASE, neutral bus support		6908.2
7	2 ANCHOR, Stainless Steel, light duty, stud bolt (w/ stud, nut and washer)		780032	7800.9

ORIGINATOR	STANDARDS COORDINATOR	STANDARDS SUPERVISOR	UNIT DIRECTOR
Ketth "BHAG HOG" Rosend	Lem S. Horn	John Clima	Belly John