


# MATERIAL STANDARD

## RACKS, UNDERGROUND CABLE

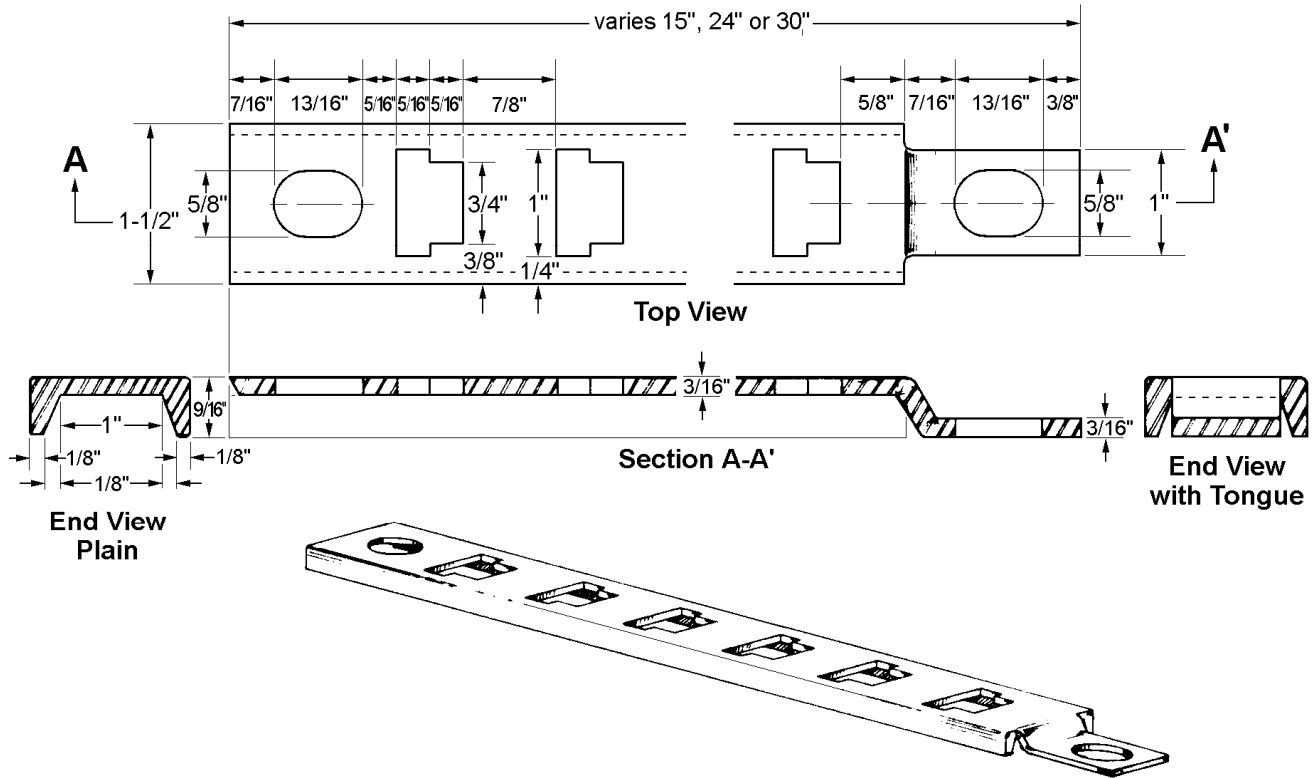

**Underground Cable Racks** shall be of the configuration shown, and shall be made of hot-rolled, carbon-steel channel conforming to ASTM Specification A 107, Grade C-1020.

Cable racks shall be galvanized, after fabrication, in accordance with ASTM Specification A 153.

**Reference Specifications:** ASTM A 107, A 153 (latest revisions)

**Stock Unit:** EA

Stock Number	Dimensions, Inches			No. of Holes	Approved Manufacturers							
	Lgth.	Spacing			Cooper	Hubbell/Chance	Inwesco	JosyIn	Kort.	MacLean	Slacan	Utility Vault
		Hook	Hole									
721662	15	1.5	13.5	8	DU17B2	C203-1124	10A05	5124	5108	617	2124	5910030
721664	24	1.5	22.5	14	DU17B3	C203-1125	10A08	5125	5114	618	2125	5910045
721666	30	1.5	28.5	18	DU17B4	C203-1126	10A11	5126	5118	619	2126	5910050

ORIGINATOR

STANDARDS COORDINATOR

STANDARDS SUPERVISOR

UNIT DIRECTOR

*Jim S. Horn*

*Charles L. Shaffer*

*John Chinner*

*Harold Gray*